

# Test Report

Report Number: L15162

Date: Jan 13, 2016

Issued by:

Dialight Optics Laboratory  
1501 Route 34 South, Farmingdale, NJ 07727

Test of one LED Floodlight  
Unit manufacturer: Dialight Corporation  
Unit model number: FLx267xC2NG

Issued to:

Dialight Corporation  
1501 Route 34 South, Farmingdale, NJ 07727

**Tests performed:** Photometric characterization and temperature measurement per the described standards.

**Dates of test:** December 18, 2015 through January 13, 2016

**Standards used:** All tests are performed in accordance with procedures and guidelines prescribed by the American National Standards Institute (ANSI) or Illuminating Engineering Society of North America (IES):

- IES LM-79:2008: Electrical and Photometric Measurements of Solid-State Lighting Products
- ANSI/UL 1598:2008: Underwriters Laboratories Inc. Standard for Safety: Luminaires
- ENERGY STAR Manufacturer's Guide for Qualifying Solid State Lighting Luminaires Version 2.1



**Description of sample:**

Sample Number: L15162  
Manufacturer: Dialight Corporation  
Product Name: LED Floodlight  
Description: LED Floodlight  
Model Number: FLx267xC2NG

## Report Summary

Sample number L15162  
Dialight unit model number FLx267xC2NG

### Photograph(s) of sample:

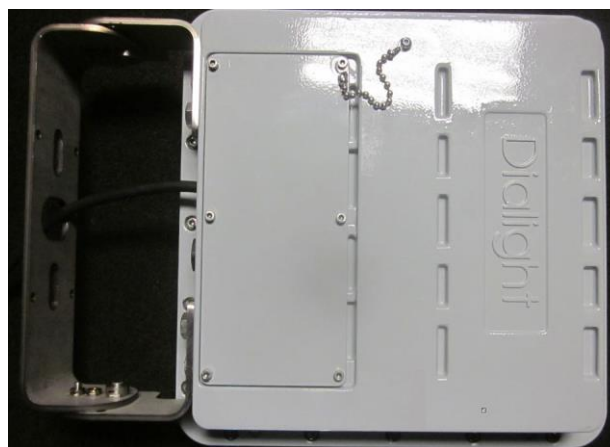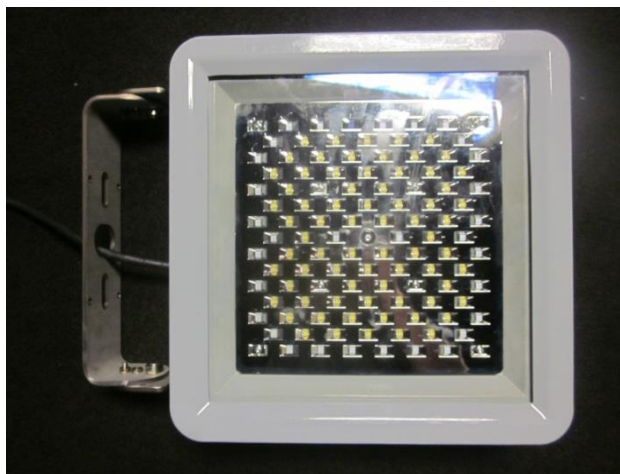

\*Photographs not to scale. For reference only.

### Summary of Results:

	<u>Integrating Sphere</u>	<u>Goniophotometer</u>
Luminous Flux:	11050 (lumens)	11068 (lumens)
Electrical Power:	106.7 (W)	106.7 (W)
Luminous Efficacy:	103.7 (lumens/W)	103.7 (lumens/W)

### Electrical Measurements:

Input Power (120VAC): 106.7 (W)  
Power Factor (120VAC): 0.995  
Current ATHD % (120VAC): 4.188  
Input Power (277VAC): 103.9 (W)  
Power Factor (277VAC): 0.919  
Current ATHD % (277VAC): 8.792

### Color Measurements:

Correlated Color Temperature (CCT): 4780  
Color Rendering Index (CRI): 71.7  
Chromaticity Coordinate (x): 0.353  
Chromaticity Coordinate (y): 0.368  
Chromaticity Coordinate (u'): 0.21  
Chromaticity Coordinate (v'): 0.329  
DUV: 0.0051

### Temperature Measurements:

In Situ LED Source Temperature: 70.0 (°C)

## Test Results: Integrating Sphere

Results include unit color, flux, efficacy and electrical power for sample number L15162.

Dialight unit model number FLx267xC2NG

### Test Conditions:


Ambient Temperature: 25 ± 1 (°C)

### Electrical Measurements:

Input Voltage: 120 (VAC)  
 Input Current: 0.891 (A)  
 Input Power: 106.7 (W)  
 Input Power Factor: 0.995  
 Current ATHD: 4.188 (%)

### Photometric measurements:

Luminous Flux: 11050 (lumens)  
 Luminous Efficacy: 103.7 (lumens/W)  
 Correlated Color Temperature (CCT): 4780 (K)  
 CRI -Ra: 71.7  
 CRI -R9: -25.6  
 DUV: 0.0051  
 CIE Coordinate (x): 0.353  
 CIE Coordinate (y): 0.368  
 CIE Coordinate (u'): 0.21  
 CIE Coordinate (v'): 0.329

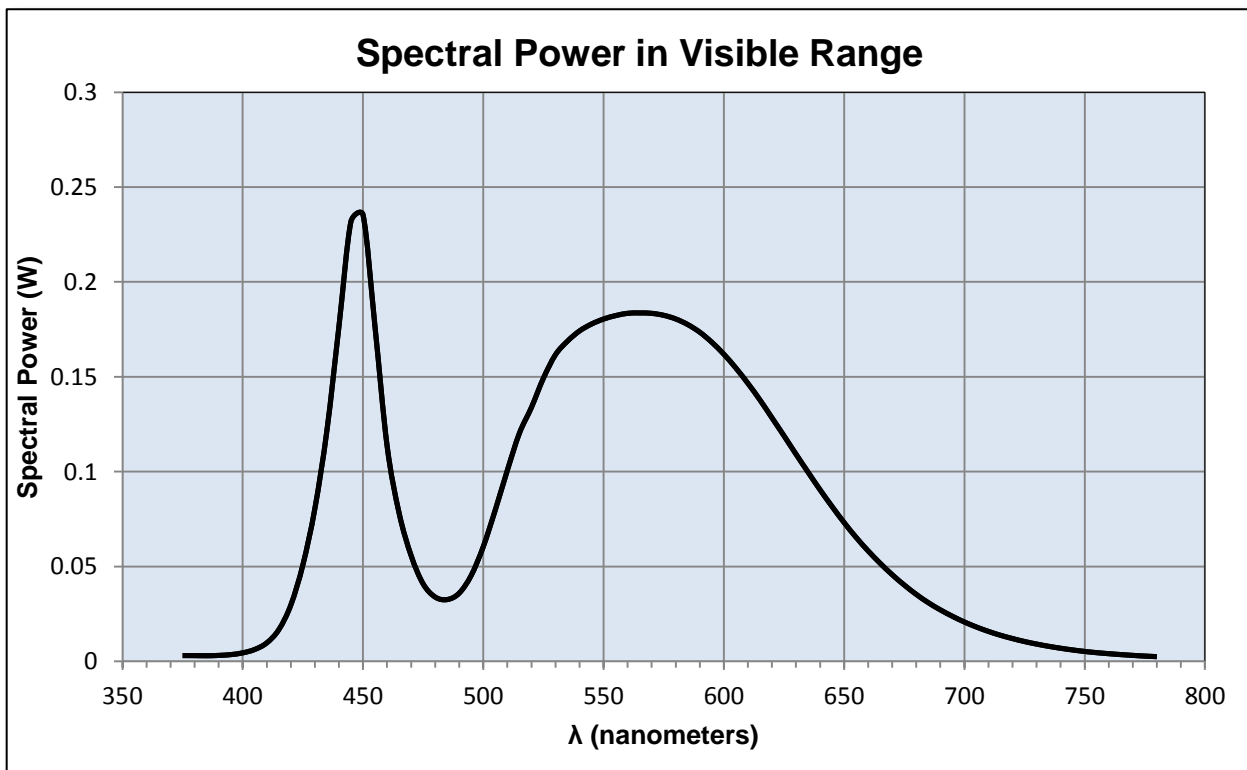

## Test Results: Integrating Sphere

Results continued from previous page.

### Tabulated Spectral Power in Visible Range:

$\lambda(\text{nm})$	(W/nm)	$\lambda(\text{nm})$	(W/nm)	$\lambda(\text{nm})$	(W/nm)
375	0.003	515	0.12	655	0.065
380	0.003	520	0.134	660	0.058
385	0.003	525	0.149	665	0.052
390	0.003	530	0.162	670	0.046
395	0.004	535	0.169	675	0.04
400	0.004	540	0.174	680	0.035
405	0.006	545	0.178	685	0.031
410	0.01	550	0.18	690	0.027
415	0.017	555	0.182	695	0.024
420	0.03	560	0.183	700	0.021
425	0.051	565	0.184	705	0.018
430	0.081	570	0.183	710	0.016
435	0.122	575	0.182	715	0.014
440	0.177	580	0.18	720	0.012
445	0.232	585	0.178	725	0.01
450	0.235	590	0.174	730	0.009
455	0.176	595	0.168	735	0.008
460	0.114	600	0.162	740	0.007
465	0.078	605	0.155	745	0.006
470	0.056	610	0.147	750	0.005
475	0.041	615	0.138	755	0.005
480	0.034	620	0.128	760	0.004
485	0.033	625	0.119	765	0.004
490	0.036	630	0.109	770	0.003
495	0.045	635	0.1	775	0.003
500	0.06	640	0.09	780	0.002
505	0.08	645	0.082		
510	0.101	650	0.073		

## Test Results: Goniometer

Results include unit flux, distribution, efficacy, and electrical power for sample number L15162.  
Dialight unit model number FLx267xC2NG

### Electrical Measurements:

Input Voltage: 120 (VAC)  
Input current: 0.893 (A)  
Input Power: 106.7 (W)  
Power Factor: 0.995

### Photometric measurements:

Absolute Luminous Flux: 11068 (lumens)  
Luminous Efficacy: 103.7 (lumens/W)

### Intensity Summary:

<u>INTENSITY (CANDLEPOWER) SUMMARY</u>						
ANGLE	ALONG	30	45	60	ACROSS	OUTPUT LUMENS
0	6242	6242	6242	6242	6242	
5	6232	6201	6147	6144	6155	232
15	6187	5726	5268	4983	4861	1217
25	6055	4987	4342	3989	3832	1948
35	5452	4033	3649	3410	3210	2393
45	5178	3434	2842	2598	2270	2508
55	2683	2307	1707	968	345	1920
65	954	994	149	64	20	780
75	9	15	5	11	6	68
85	1	1	1	1	1	3
95	0	0	0	0	0	0
105	0	0	0	0	0	0
115	0	0	0	0	0	0
125	0	0	0	0	0	0
135	0	0	0	0	0	0
145	0	0	0	0	0	0
155	0	0	0	0	0	0
165	0	0	0	0	0	0
175	0	0	0	0	0	0
180	0	0	0	0	0	0


### ZONAL LUMEN AND PERCENTAGES

ZONE	LUMENS	% LUMINAIRE
0-30	4557.03	41.2%
0-40	7050.99	63.7%
0-60	10710.52	96.8%
60-90	576.15	5.2%
0-90	11067.82	100.0%
90-180	0	0.0%
0-180	11067.82	100.0%

## Test Results: Goniometer

Results continued from previous page.

**Polar Plot:**

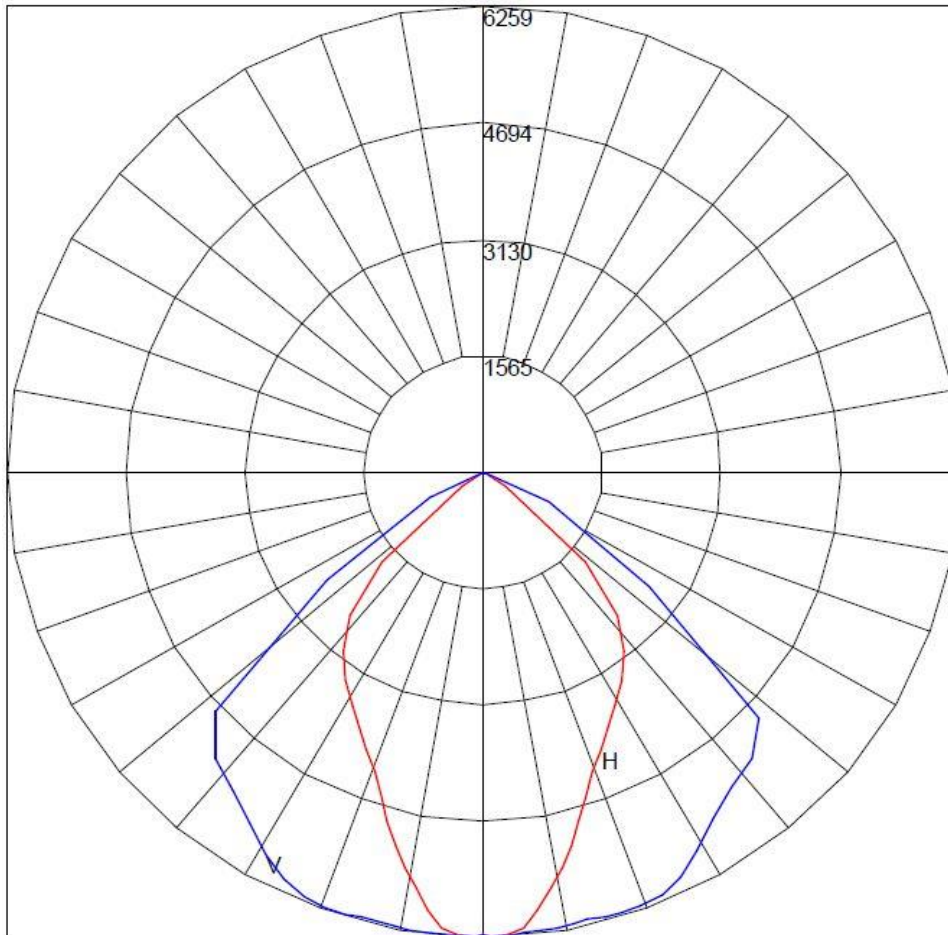

Target % of Peak Intensity	Beam Angle to % Intensity Value (degrees)	Beam Angle to Specified % Intensity Value (degrees) [-]
50.00	106.22	72.63

Beam Spread (at 50% Max CD)		Field Spread (at 10% Max CD)		IESNA LM-35-02 Floodlight Designation	
(deg) Horiz	(deg) Vert	(deg) Horiz	(deg) Vert	IESNA LM-35-02 Floodlight H Designation	IESNA LM-35-02 Floodlight V Designation
71.77	106.46	107.10	135.42	6	7

Total Luminous Flux	Field (%)	Field Flux (lm)	Beam Flux (%)	Beam Flux (lm)	Beam Spill (%)	Spill Flux (lm)
11006.04	98.42	10831.74	71.82	7904.15	1.58	174.29




## Test Results: Goniometer

Results continued from previous page.

### Illuminance Plot:

Illuminance Contour Graph

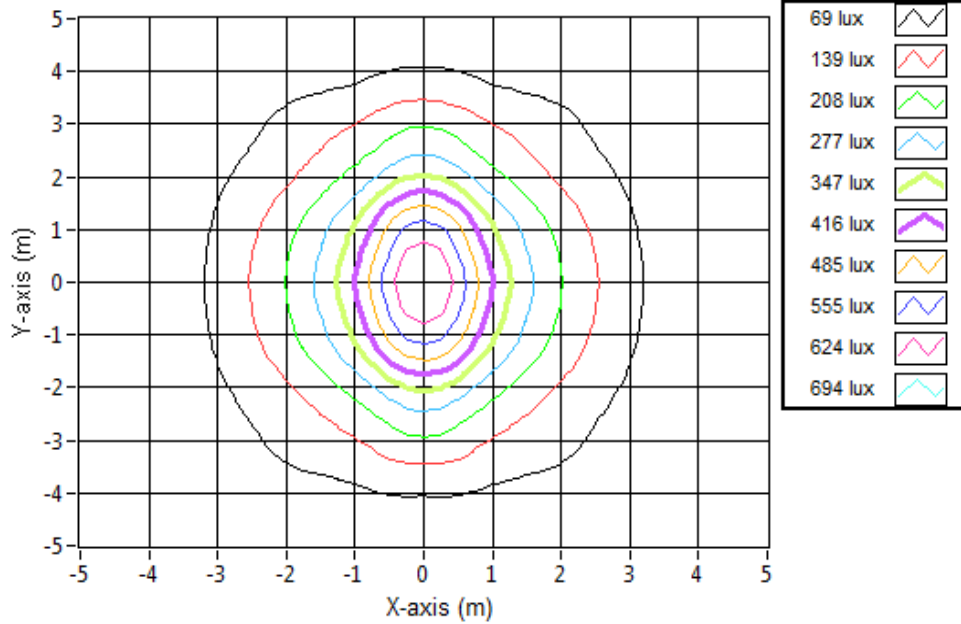

### Illuminance-Cone of Light:

Mounting Height (m)	Beam Cone Width (m)	Orthogonal Beam Cone Width (m)	Projected Illuminance (lux)
3.048	8.12	4.48	671.9
6.096	16.24	8.96	168.0
9.144	24.36	13.44	74.7
12.192	32.49	17.92	42.0
15.24	40.61	22.40	26.9
18.288	48.73	26.88	18.7
21.336	56.85	31.36	13.7
24.384	64.97	35.85	10.5
27.432	73.09	40.33	8.3
30.48	81.22	44.81	6.7

## Test Results: In Situ Temperature Measurement Test

Results include maximum LED chip temperature for sample number L15162.  
Dialight unit model number FLx267xC2NG

LED identified as Cree part number XTEAWT.

LED drive current (as indicated by customer): 425 (mA)

### LED Specifications:

LED specifications are taken from LED manufacturer datasheet:

Maximum Forward Current (If): 1500 (mA)  
Maximum Rated Power Dissipation: 5.25 (W)  
Maximum Junction Temp. (Tj): 150 (°C)  
Thermal Resistance (Rth): 5 (°C/W)

Derived Specifications:



Maximum Power at Indicated Current: 1.488 (W)  
Maximum Source Temperature: 142.6 (°C)

### Test Conditions:

Temperature Measurement Location: See Photographs Below  
Ambient Temperature:  $25^{\circ} \pm 1'$  (°C)  
Ambient temperature at time of measurement: 25.1 (°C)  
Relative humidity at time of measurement: 11%

### Results:

Measured LED source temperature: 70 (°C)

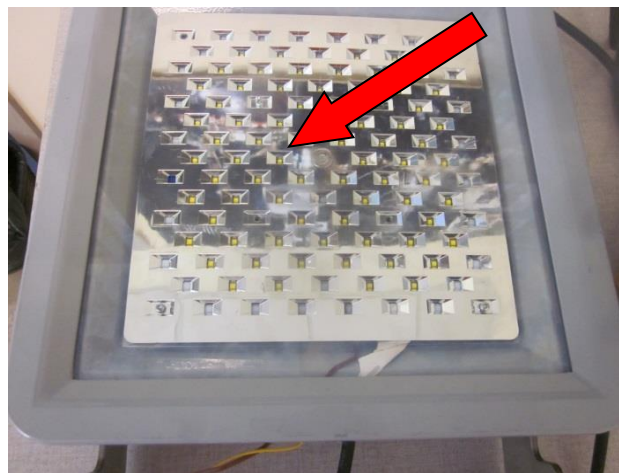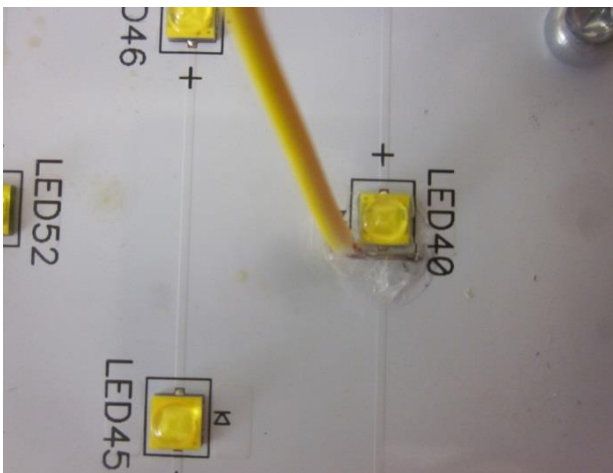



**Equipment Used:**

Equipment Name	Model Number
Omega TC	Dpi8
Fluke 8808A Digit Multimeter	8808A
YOKOGAWA Digital Power Meter	11/26/3981
LSI High Speed Mirror Goniometer	6240T
Instrument System Spectrometer	CAS140B-151
Instrument System 1.5 Meter Sphere	ISP1500
Volttech Power Analyzer	PM1000+
Delta Elektronika DC Power Supply	SM.300-5
Elgar AC Power Supply	CW1251P
Instek AC Power Supply	APS-9501
Sorensen DC Power Supply	XHR150-7
Extech Hygro-Thermometer	4/16/3120
Extech Hygro-Thermometer	4/16/3120
Fluke 52II Thermometer	52II Thermometer
Volttech Power Analyzer	PM1000+
BK Precision	1715A
TDK-Lambda	GEN1500W
Fluke 8808A Digit Multimeter	8808A
TPI Digital Thermometer 343	TPI 343
TPI Digital Thermometer 343	TPI 343
Step-Up Transformer	
Omega TC	Dpi8-C24
Agilent True RMS OLED Multimeter	U1273A
Adaptive Power Systems AC Power Supply	FC-210
Xitron Power Analyzer	XT2640

**Additional Notes:**

Samples are received and tested in new and undamaged condition, unless otherwise noted. The results shown in this report are representative only of the test samples submitted. This data has been issued to the assignee for further evaluation. This report shall not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the Federal Government. This report shall not be reproduced, except in full, without the express written permission of Dialight Optics Laboratory.

Test Report Issued By:

Richard Huegi  
 Dialight Optics Laboratory  
 Senior Optical Engineering Technician  
 Lighting Division

Test Report Reviewed and Approved By:

Vishnu Shastry  
 Dialight Optics Laboratory  
 Optical Engineer  
 Approved Signatory